


Key

- Site boundary
- Stage II VR
- Unleaded
- Diesel
- Super Unleaded
- Super Diesel
- OSF line
- Vent line
- Stage 1 B Return (vapour recovery)

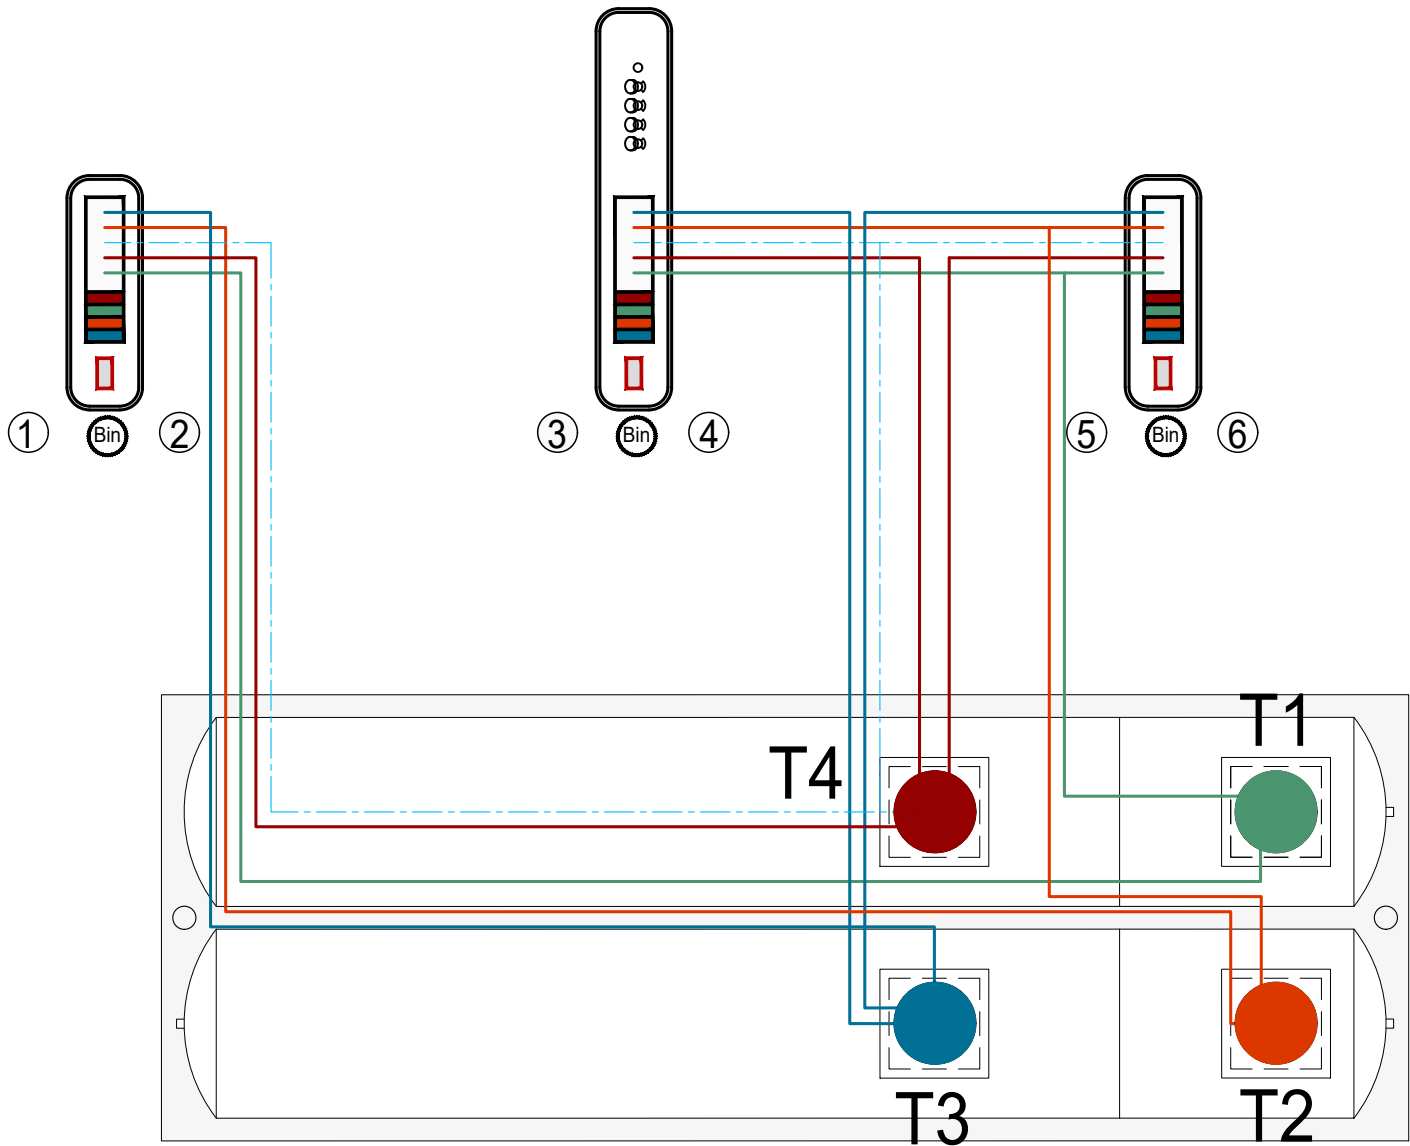

CONTROL

Tank No.	Tank Capacity (Its)	Safe Working Capacity 95% (Its)	Label	Grade	Pump No.
1	15,000	14,250	E5	UUL	P1-6
2	15,000	14,250	B7	UAD	P1-6
3	60,000	57,000	B7	AD	P1-6
4	60,000	57,000	E5	UL	P1-6

REVISIONS

CLIENT EG ON THE MOVE

PROJECT BROOMFIELD S/S
MAIN ROAD
CM1 7DH

TITLE TANK TO PUMP
LAYOUT

DATE 22.05.26

SCALE 1:100 @ A3

JOB ID 2298

DWG 21